



## Star-Delta Starters Open Type

92


 Star-Delta Starters Enclosed  
Enclosure for Star-Delta Starters

 94  
94


## Accessories

95



## Reversing Contactors

96




## Pole Changing Starters

98



## Technical Data

100

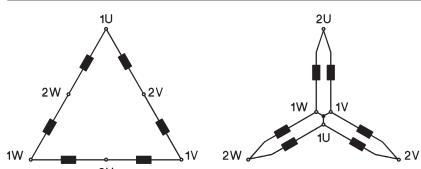

## Wiring Diagrams

103



## Dimensions

107

## Star-Delta Starters Open Type

AC Operated



Ratings AC3 <b>380V</b> <b>400V</b> <b>415V</b> <b>kW</b>	Rated Current 660V 500V kW	AC3 690V 400V A	order separately Overload Relay Type	Type <b>230</b> <b>400</b>	Coil voltage <sup>1)</sup> 220-240V 50Hz 380-415V 50Hz	Pack pcs.	Weight kg/pc.
<b>7,5</b>	7,5	11	16	<b>K3NY15 ...</b>	1	0,9	
<b>15</b>	18,5	15	30	<b>K3NY26 ...</b>	1	0,9	
<b>22</b>	30	22	45	<b>K3Y40 ...</b>	1	1,4	
<b>30</b>	37	30	60	<b>K3Y52 ...</b>	1	1,8	
<b>45</b>	55	45	85	<b>K3Y80 ...</b>	1	3,5	
<b>55</b>	75	55	109	<b>K3Y100 ...</b>	1	3,7	
<b>75</b>	90	90	150	<b>K3Y140 ...</b>	1	6,6	
<b>110</b>	132	110	205	<b>K3Y200 ...</b>	1	7	
<b>132</b>	160	160	240	<b>K3Y240 ...</b>	1	15	
<b>160</b>	180	180	300	<b>K3Y300 ...</b>	1	15	

Star-delta starters are wired to accept thermal overload relay. The thermal overload relay has to be ordered separately. For full load current setting use the YD-dial of thermal overload relay.

**Ordering Example:** Star-Delta Starter, open type, rated AC3 at 400V 205A rated control voltage 230V 50Hz - **Order Type:** K3Y200 230 + U85 120


## Thermal Overload Relays

Rated Motor Current A	Type	Pack pcs.	Weight kg/pc.	Wiring Diagram
--------------------------	------	--------------	------------------	----------------

For Star-Delta Starters K3NY15.. to K3Y40..



7 - 10,5	<b>U12/16E 6 K3</b>	1	0,10
10,5 - 15,5	<b>U12/16E 9 K3</b>	1	0,10
14 - 19	<b>U12/16E 11 K3</b>	1	0,10
18 - 24	<b>U12/16E 14 K3</b>	1	0,10
23 - 31	<b>U12/16E 18 K3</b>	1	0,10




manual reset

For Star-Delta Starters K3NY15.. to K3Y52..



7 - 10,5	<b>U3/32 6</b>	1	0,14
10,5 - 15,5	<b>U3/32 9</b>	1	0,14
14 - 19	<b>U3/32 11</b>	1	0,14
18 - 24	<b>U3/32 14</b>	1	0,14
23 - 31	<b>U3/32 18</b>	1	0,14
30 - 41	<b>U3/32 24</b>	1	0,14
40 - 55	<b>U3/32 32</b>	1	0,14




manual and auto reset

For Star-Delta Starters K3Y40.., K3Y52..



24 - 35	<b>U3/42 20</b>	1	0,30
35 - 48	<b>U3/42 28</b>	1	0,30
48 - 73	<b>U3/42 42</b>	1	0,30



manual and auto reset

1) Coil voltage range and other coil voltages see page 100

Components for Combinations		Star Contactor	Electronic Timer	Mechanical Interlock between K2 and K3 Type	Star-Delta Starter Connector Type	Auxiliary Contacts			Free Space for Aux. Contact Blocks on Contactor			
Line Contactor	Delta Contactor					Built-in for use on Contactor	Line K1	Delta K2	Star K3	Line K1	Delta K2	Star K3
K1 Type	K2 Type	K3 Type	K4 Type			NO/NC	NO/NC	NO/NC	HN.. or HA..			
K3-10ND01 + HN10	K3-10ND01	K3-10ND10 + HN10 + HN01	Y9A	LG10889	K3NYVB10	-	-	-	3	4	2	
K3-18ND01 + HN10	K3-18ND01	K3-14ND10 + HN10 + HN01	Y9A	LG10889	K3NYVB10	-	-	-	3	4	2	
K3-24A00 + HN10 + HN01	K3-24A00 + HN01	K3-24A00 + 2HN10 + HN01	Y9A	LG10889	K3Y-VB24	-	-	-	2	3	1	
K3-32A00 + HN10 + HN01	K3-32A00 + HN01	K3-24A00 + 2HN10 + HN01	Y9A	LG10889	K3Y-VB24	-	-	-	2	3	1	
K3-50A00 + HN01 + HN10	K3-50A00 + HN01	K3-32A00 + 2HN10 + HN01	Y9A	LG10890	-	-	-	-	2	3	1	
K3-62A00 + HN01 + HN10	K3-62A00 + HN01	K3-50A00 + 2HN10 + HN01	Y9A	LG10890	-	-	-	-	2	3	1	
K3-90A00 + HN01 + HN10	K3-90A00 + HN01	K3-90A00 + 2HN10 + HN01	Y9AL	LG11478	-	-	-	-	5	6	4	
K3-115A00 + HN01 + HN10	K3-115A00 + HN01	K3-90A00 + 2HN10 + HN01	Y9AL	LG11478	-	-	-	-	5	6	4	
K3-151A00 + HKT11	K3-151A00 + HKT11	K3-151A00 + HKT22	Y9AL	LG11223H	-	-	-	1/-	-/1	2	1	1
K3-176A00 + HKT11	K3-176A00 + HKT11	K3-151A00 + HKT22	Y9AL	LG11223H	-	-	-	1/-	-/1	2	1	1

## Applications

The star-delta starting method is only practicable in such cases where the motor windings are connected in delta configuration for normal operation and the torque which is needed during the starting period is not higher than approx. 30% of the rated torque. The starting current drawn from the line will be approx. 2 to 2,7 times the rated motor current.

## Time setting

The transition from start (star configuration) to normal operation (delta configuration) should be after the motor achieves practically full rotational speed. The use of star-delta timer Y9A with a dwell period of approx. 25ms provides a careful operation of motor and drive equipment.

## Thermal Overload Relays

Rated Motor Current  
A

For Star-Delta Starters K3Y80.., K3Y100..




35 - 48	<b>U3/74 28</b>	1	0,40
48 - 73	<b>U3/74 42</b>	1	0,40
70 - 90	<b>U3/74 52</b>	1	0,40
90 - 112	<b>U3/74 65</b>	1	0,40

Type

Pack  
pcs.  
Weight  
kg/p.c.

Wiring Diagram



For Star-Delta Starters K3Y140.., K3Y200..




104 - 156	<b>U85 90</b>	1	0,90
140 - 207	<b>U85 120</b>	1	0,90

**U85 90**  
**U85 120**

1  
1

0,90  
0,90

manual reset



For Star-Delta Starters K3Y240.., K3Y300..




208 - 312	<b>U180 180</b>	1	1,5
-----------	-----------------	---	-----

**U180 180**

1

1,5

manual and  
auto reset



## Star-Delta Starters Enclosed Type

AC Operated

Ratings	Rated Current	Optional Extras	Wired to accept Overload Relay	Type	230	400	Coil voltage <sup>1)</sup> 220-240V 50Hz 380-415V 50Hz	Pack pcs.	Weight kg/pc.
AC3									
<b>380V</b>									
<b>400V</b>	660V	AC3							
<b>415V</b>	500V	690V	400V						
<b>kW</b>	<b>kW</b>	<b>kW</b>	<b>A</b>						
				Type					

**Plastic Enclosed**, protected to IP65



<b>7,5</b>	7,5	11	16	ST	U3/32	<b>K3NY15P ...</b>	1	1,8
<b>15</b>	18,5	15	30	ST		<b>K3NY26P ...</b>	1	1,8
<b>22</b>	30	22	45	ST, H	U3/42	<b>K3Y40P ...</b>	1	3,8
<b>30</b>	37	30	60	ST, H		<b>K3Y52P ...</b>	1	4,2
<b>45</b>	55	45	85	ST, H	U3/74	<b>K3Y80P ...</b>	1	5,9
<b>55</b>	75	55	109	ST, H		<b>K3Y100P ...</b>	1	8,7

**Sheet Steel Enclosed**, protected to IP54



<b>7,5</b>	7,5	11	16	ST,H	U3/32	<b>K3NY15B ...</b>	1	2,8
<b>15</b>	18,5	15	30	ST, H		<b>K3NY26B ...</b>	1	2,8
<b>22</b>	30	22	45	ST, H	U3/42	<b>K3Y40B ...</b>	1	4,8
<b>30</b>	37	30	60	ST, H		<b>K3Y52B ...</b>	1	5,2
<b>45</b>	55	45	85	ST, H	U3/74	<b>K3Y80B ...</b>	1	15
<b>55</b>	75	55	109	ST, H		<b>K3Y100B ...</b>	1	15
<b>75</b>	90	90	150	ST, H	U85	<b>K3Y140B ...</b>	1	22
<b>110</b>	132	110	205	ST, H		<b>K3Y200B ...</b>	1	22

1) Coil voltage range and other coil voltages see page 100

**Type-suffix** for optional extras

Start-Stop Push Buttons

Selector Switch

Typical wiring diagrams see page 103-106

Control Circuit Fuse

<250V (1 piece)

>250V (2 pieces)

Run Hour Meter

.....T ...

.....W ...

.....ST ...

.....ST ...

.....H ...

**Ordering Example:** Star-Delta Starter, steel sheet enclosed, with selector switch and run hour meter rated AC3 at 400V 82A, rated control voltage 230V 50Hz - **Order Type:** K3Y80BWH 230 + U3/74 52

## Enclosures for Star Delta Starter

for Starter	accept Overload Relay	Type	Pack pcs.	Weight kg/pc.
-------------	-----------------------	------	-----------	---------------

**Plastic** IP65



<b>K3NY15, K3NY26</b>	U3/32	<b>K3Y26P-G3</b>	1	1,0
<b>K3Y40, K3Y52</b>	U3/42, U3/32	<b>K3Y40/52P-G3</b>	1	2,4

**Sheet Steel** IP54

<b>K3NY15, K3NY26</b>	U3/32	<b>K3Y26B-G3</b>	1	3,4
<b>K3Y40, K3Y52</b>	U3/42, U3/32	<b>K3Y40/52B-G3</b>	1	3,4

## Star-Delta Starter Connector



For Star-Delta Starter Types

K3NY15, K3NY26  
K3Y40, K3Y52**Type**Pack  
pcs.Weight  
kg/pc.**K3NY-VB10**  
**K3Y-VB24**1  
10,02  
0,03

## Additional Terminals

For Star-Delta Starter Types  
Line Conn. Motor Conn.  
Line Contactor Overload RelayCable  
cross-section  
mm<sup>2</sup>**Type**Pack  
pcs.Weight  
kg/pc.**Single pole with Fingertouch Protection**

K3NY15, K3NY26 U12/16

0,75 - 10 solid  
0,75 - 6 flex.**LG9339**

6

0,009

**Three-pole with Fingertouch Protection**

U3/42

4 - 35 strand.  
4 - 25 flex.**LG7559**

1

0,052

## Electronic Timers for Star-Delta Starters<sup>1)</sup>



Rated Control Voltage V	Time Range s	Delay Time ms	Rated Current AC15		<b>Type</b>	Pack pcs.	Weight kg/pc.
			230V A	400V A			
24 - 60V AC	1 - 20	20 - 25	6	4	<b>Y9A 60</b>	1	0,075
110 - 415V AC	1 - 20	20 - 25	6	4	<b>Y9A 415</b>	1	0,075
24 - 60V~	1 - 20	40 - 80	6	4	<b>Y9AL 60</b>	1	0,075
110 - 415V~	1 - 20	40 - 80	6	4	<b>Y9AL 415</b>	1	0,075

Time repeat accuracy	$\pm 1\%$
Minimum interval between operations	2s
Short circuit protection	4A gl (gG)

Power consumption at	24V	0,2VA
	60V	5VA
	220-240V	2VA
	380-415V	7VA

1) not suitable for contactors K3-450 - K3-1200

## Mounting Bar



Specification

For screw mounting of electronic timer Y9...

**Type**Pack  
pcs.Weight  
kg/pc.**LG7735**

10

0,09

## Star-Delta Starters in Special Versions

### Starters for Longer Starting Time

For longer starting times the thermal overload relay is mounted on delta-contactor. The motor is not protected in Y-connection. The timer used for this starter-type is the type Y91A, time range is 10 to 60s.  
Principal wiring diagram see page 104.

**Ordering Example:** K3YL52 230

### Starters with two Thermal Overload Relays on request

Basic circuit diagram see page 104

## Reversing Contactors with Mechanical Interlock

### AC Operated

<b>Ratings</b>	Rated Current	Vorbereitet für Einbau	Wired to accept Overload Relay	Type	Coil voltage <sup>1)</sup>	Pack pcs.	Weight kg/pc.
AC3				<b>110</b>	110V 50Hz		
<b>380V</b>				<b>230</b>	220-240V 50Hz		
<b>400V</b>	660V	AC3		<b>400</b>	380-415 50Hz		
<b>415V</b>	500V	690V	400V				
<b>kW</b>	<b>kW</b>	<b>kW</b>	<b>A</b>				

Open Type



<b>4</b>	5,5	5,5	10	U3/32 U12/16E K3	<b>K3NWU10 ...</b>	1	0,6
<b>7,5</b>	10	7,5	18		<b>K3NWU18 ...</b>	1	0,6
<b>11</b>	15	15	24	U3/42	<b>K3WU24 ...</b>	1	1,2
<b>15</b>	18,5	18,5	32		<b>K3WU32 ...</b>	1	1,4
<b>18,5</b>	18,5	18,5	40		<b>K3WU40</b>	1	1,4
<b>22</b>	30	30	50	U3/74	<b>K3WU50 ...</b>	1	2,5
<b>30</b>	37	37	62		<b>K3WU62 ...</b>	1	2,5
<b>37</b>	45	45	74		<b>K3WU74 ...</b>	1	2,5

Sheet Steel Enclosed, protected to IP54



<b>4</b>	5,5	5,5	10	U3/32	<b>K3NWU10B ...</b>	1	3,9
<b>7,5</b>	10	7,5	18		<b>K3NWU18B ...</b>	1	4,1
<b>11</b>	15	15	24	U3/42	<b>K3WU24B ...</b>	1	4,5
<b>15</b>	18,5	18,5	32		<b>K3WU32B ...</b>	1	4,7
<b>22</b>	30	30	50	U3/74	<b>K3WU50B ...</b>	1	7,1
<b>30</b>	37	37	62		<b>K3WU62B ...</b>	1	7,1

## Reversing Starter Connector



For Reversing Starter Types

K3NWU10, K3NWU18  
K3WU24, K3WU32

Type	Pack pcs.	Weight kg/pc.
<b>K3NW-VB10</b>	1	0,02
<b>K3W-VB24</b>	1	0,025

1) Other coil voltages see page 57

Components for Combinations								Contactors, Motor-Starter			
Left Hand Side Contactor	Right Hand Side Contactor	Mechanical Interlock	Reversing Starter Connector	Auxiliary Contacts Built-in for use on Contactor		Free Space for Aux. Contact Blocks on Contactor					
K1 Type	K2 Type	Type	Type	K1 NO/NC	K2 NO/NC	K1 HN.. or HA..	K2				
K3-10ND10 + HN01	K3-10ND10 + HN01	LG10889	K3NW-VB10	-	-	3	3	Circuit Breakers			
K3-18ND10 + HN01	K3-18ND10 + HN01	LG10889	K3NW-VB10	-	-	3	3				
K3-24A00 + HN10 + HN01	K3-24A00 + HN10 + HN01	LG10889	K3W-VB24	-	-	2	2	Manual Motor-Starters			
K3-32A00 + HN10 + HN01	K3-32A00 + HN10 + HN01	LG10889	K3W-VB24	-	-	2	2				
K3-40A00 + HN10 + HN01	K3-40A00 + HN10 + HN01	LG10889	K3W-VB24	-	-	2	2				
K3-50A00 + HN10 + HN01	K3-50A00 + HN10 + HN01	LG10890	-	-	-	2	2				
K3-62A00 + HN10 + HN01	K3-62A00 + HN10 + HN01	LG10890	-	-	-	2	2	Switches			
K3-74A00 + HN10 + HN01	K3-74A00 + HN10 + HN01	LG10890	-	-	-	2	2				
K3-10ND10 + HN01	K3-10ND10 + HN01	LG10889	K3NW-VB10	-	-	3	3	AC-Main Switches			
K3-18ND10 + HN01	K3-18ND10 + HN01	LG10889	K3NW-VB10	-	-	3	3				
K3-24A00 + HN10 + HN01	K3-24A00 + HN10 + HN01	LG10889	K3W-VB24	-	-	2	2				
K3-32A00 + HN10 + HN01	K3-32A00 + HN10 + HN01	LG10889	K3W-VB24	-	-	2	2				
K3-50A00 + HN10 + HN01	K3-50A00 + HN10 + HN01	LG10890	-	-	-	2	2				
K3-62A00 + HN10 + HN01	K3-62A00 + HN10 + HN01	LG10890	-	-	-	2	2	DC-Switch Disconnector			
Push Buttons											
Representatives, Suppliers											

## Pole Changing Starters

AC Operated

Ratings		Rated Current	Wired to accept Overload Relay	Type	Coil voltage <sup>1)</sup>
AC3				<b>230</b>	220-240V 50Hz
<b>380V</b>				<b>400</b>	380-415 50Hz
<b>400V</b>	660V	AC3			
<b>415V</b>	500V	690V	400V		
<b>kW</b>	kW	kW	A		
			page 120 Type		

### Open Type



<b>7,5</b>	10	10	18	2 x U3/32 2 x U12/16E K3	<b>K3NPU18 ...</b>	1	1,0
<b>11</b>	15	15	24		<b>K3NPU24 ...</b>	1	1,5
<b>15</b>	18,5	18,5	32	2 x U3/32	<b>K3PU32 ...</b>	1	1,9
<b>22</b>	30	30	50	2 x U3/74	<b>K3PU50 ...</b>	1	3,9
<b>30</b>	37	37	62		<b>K3PU62 ...</b>	1	3,9

### Sheet Steel Enclosed, protected to IP54



<b>7,5</b>	10	7,5	18	2x U3/32	<b>K3NPU18B ...</b>	1	1,0
<b>11</b>	15	15	24		<b>K3NPU24B ...</b>	1	1,5
<b>15</b>	18,5	18,5	32		<b>K3PU32B ...</b>	1	1,9

**Ordering Example:** Pole Changing Starter, open version, rated AC3 at 400V 28A and 15A, control voltage 230V 50Hz  
**Order Type:** **K3PU32 230 + U3/32 32 + U3/32 18**

Pole Changing Starters for Star-Delta Operation on request

1) Other coil voltages see page 57

Components for Combinations High Speed	Low Speed	Star Contactor	Free Space for Aux. Contact Blocks on Contactor		
K1 Type	K2 Type	K3 Type	High Speed K1 HN.. or HA..	Low Speed K2	Star K3

K3-18ND01 + 2 x HN10	K3-18ND01 + HN10	K3-14ND10	2	3	4
----------------------	------------------	-----------	---	---	---

K3-24A00 + HN01 + 2 x HN10	K3-24A00 + HN01 + HN10	K3-18ND10	1	2	4
----------------------------	------------------------	-----------	---	---	---

K3-32A00 + HN01 + 2 x HN10	K3-32A00 + HN01 + HN10	K3-24A00 + HN10	1	2	3
----------------------------	------------------------	-----------------	---	---	---

K3-50A00 + HN01 + 2 x HN10	K3-50A00 + HN01 + HN10	K3-32A00 + HN10	1	2	3
----------------------------	------------------------	-----------------	---	---	---

K3-62A00 + HN01 + 2 x HN10	K3-62A00 + HN01 + HN10	K3-50A00 + HN10	1	2	3
----------------------------	------------------------	-----------------	---	---	---

K3-18ND01 + 2 x HN10	K3-18ND01 + HN10	K3-14ND10	2	3	4
----------------------	------------------	-----------	---	---	---

K3-24A00 + HN01 + 2 x HN10	K3-24A00 + HN01 + HN10	K3-18ND10	1	2	4
----------------------------	------------------------	-----------	---	---	---

K3-32A00 + HN01 + 2 x HN10	K3-32A00 + HN01 + HN10	K3-24A00 + HN10	1	2	3
----------------------------	------------------------	-----------------	---	---	---

## Star-Delta Starters

Data according to IEC 947-4-1, VDE 0660, EN 60947-4-1

Type		K3NY15	K3NY26	K3Y40	K3Y52	K3Y80	K3Y100	K3Y140	K3Y200	K3Y240	K3Y300
<b>Main Contacts</b>											
<b>Rated insulation voltage <math>U_i^{(1)}</math></b>	VAC	690	690	690	690	690	690	690	690	690	690
<b>Frequency of operations z</b> AC3, $I_e$ Change-over time max. (Y-step)	1/h s					15 20 (Type K3YL ... 60)					
<b>Utilization category AC3</b>											
<b>Switching of three-phase motors</b>											
Rated operational current $I_e$	220-230V A 240V A <b>380-400V A</b>	16 16 <b>16</b>	30 30 <b>30</b>	45 45 <b>45</b>	60 60 <b>60</b>	85 85 <b>85</b>	109 109 <b>109</b>	150 150 <b>150</b>	205 205 <b>205</b>	240 240 <b>240</b>	300 300 <b>300</b>
	415-440V A 500V A 660-690V A	15 15 13	30 30 17	45 45 30	60 60 36	85 85 57	109 95 72	150 150 103	205 205 118	240 190 147	300 240 180
Rated operational power of three-phase motors 50-60Hz	220-230V kW 240V kW <b>380-400V kW</b>	4 5,5 <b>7,5</b>	7,5 11 <b>15</b>	11 15 <b>22</b>	15 18,5 <b>30</b>	22 22 <b>45</b>	30 30 <b>55</b>	45 45 <b>75</b>	55 55 <b>110</b>	75 75 <b>110</b>	90 90 <b>132</b>
	415-440V kW 500V kW 660-690V kW	7,5 7,5 11	15 18,5 15	22 30 22	30 37 30	45 55 45	55 75 55	75 90 90	110 132 110	140 132 132	170 180 180
<b>Cable cross-sections</b>											
Line	solid or stranded flexible with multicore cable end	mm <sup>2</sup> mm <sup>2</sup> mm <sup>2</sup>	1,5 - 6 <sup>2)</sup> 1,5 - 4 <sup>2)</sup> 1,5 - 4 <sup>2)</sup>		1,5 - 16 1,5 - 16 1,5 - 16		10 - 70 <sup>3)</sup> 16 - 50 <sup>3)</sup> 10 - 35		10 - 120 10 - 95 10 - 95		busbar 18x5 M8
Motor	solid or stranded flexible with multicore cable end	mm <sup>2</sup> mm <sup>2</sup> mm <sup>2</sup>	1,5 - 6 1,5 - 4 1,5 - 4		1,5 - 16 1,5 - 16 1,5 - 16		4 - 35 <sup>3)</sup> 6 - 25 <sup>3)</sup> 4 - 25		10 - 120 10 - 95 10 - 95		busbar 18x5 M8
<b>Power consumption of the combination</b>											
inrush and change-over sealed	VA VA W		55 20 6		130 26 8		183 36 14		560 10 10		700 10 10

## Coil Voltage Ranges and Non Standard Voltages for Star-Delta Starters

### K3NY15.. to K3Y100..

Prefix to Star-Delta Starter type e.g. K3Y80 400	Rated Control Voltage $U_s$ range for 50Hz min. V max. V	range for 60Hz min. V max. V
24	24	24
42	42	47
110	100	110
180	180	210
230	220	240
400	<b>380</b>	<b>415</b>
		200
		240
		<b>230</b>
		<b>264</b>
		400
		<b>415</b>

### K3Y140, to K3Y300..

Prefix to Star-Delta Starter type e.g. K3Y300 230	Rated Control Voltage $U_s$ range for 50Hz min. V max. V	range for 60Hz min. V max. V	for DC V
24	24	24	24
48	48	48	48
110	110	120	110
<b>230</b>	<b>220</b>	<b>240</b>	<b>220</b>
<b>400</b>	<b>380</b>	<b>415</b>	<b>240</b>
			-

Standard voltages in bold type letters

1) Suitable for: earthed-neutral systems, overvoltage category I to IV, pollution degree 3 (standard-industry):  $U_{imp} = 8kV$ . Data for other conditions on request.

2) Additional terminals see page 95

3) Maximum cable cross-section with prepared conductor

## Reversing Starters

Data according to IEC 947-4-1, VDE 0660, EN 60947-4-1

Type		K3NWU10	K3NWU18	K3WU24	K3WU32	K3WU50	K3WU62	K3WU74
<b>Main Contacts</b>								
<b>Rated insulation voltage <math>U_i^{(1)}</math></b>	V AC	690	690	690	690	690	690	690
<b>Utilization category AC3</b>								
<b>Switching of three-phase motors</b>								
Rated operational current $I_e$	220V A 230V A 240V A	12 11,5 11	18 18 18	23 24 24	30 32 32	45 50 50	63 62 62	74 74 74
	<b>380-400V A</b>	<b>10</b>	<b>18</b>	<b>24</b>	<b>32</b>	<b>50</b>	<b>62</b>	<b>74</b>
	415-440V A 500V A 660-690V A	9 9 6,5	18 16 8,5	23 23 17	30 30 20	50 45 31	62 60 40	74 74 40
Rated operational power of three-phase motors 50-60Hz	220-230V kW 240V kW <b>380-400V kW</b>	3 3 <b>4</b>	5 5 <b>7,5</b>	6 7 <b>11</b>	8,5 9 <b>15</b>	12,5 13,5 <b>22</b>	18,5 19 <b>30</b>	23 <b>37</b>
	415-440V kW 500V kW 660-690V kW	4,5 5,5 5,5	8,5 10 10	12 15 15	16 18,5 18,5	24 30 30	33 37 37	40 45 45
<b>Cable cross-sections</b>								
Line solid or stranded mm²		0,75 - 6		1,5 - 25			4 - 50	
flexible mm²		1 - 4		2,5 - 16			6 - 35	
flexible with multicore cable end mm²		0,75 - 4		1,5 - 16			6 - 35	
Cables per clamp		1		1			1	
<b>Power consumption of the combination</b>								
inrush and change-over sealed VA		33 - 45		90 - 115			140 - 185	
sealed VA		7 - 10		9 - 13			13 - 18	
	W	2,6 - 3		2,7 - 4			5,4 - 7	

## Technical Data according to UL508

Main Contacts (cULus)	Type	KNW3-10	KNW3-18	KW3-24	KW3-32	KW3-40
Rated operational power of three-phase motors at 60Hz (3ph)	110-120V hp 200V hp 220-240V hp 277V hp	1½ 3 3 3	2 5 7½ 7½	5 7½ 10 7½	5 10 10 10	7½ 10 15 15
	380-415V hp 440-480V hp 550-600V hp	5 5 7½	10 10 15	10 15 20	15 20 25	20 25 30
Fuse / Short-circuit current	A/kA	30/5	50/5	90/5	125/5	175/5
Rated voltage	V	600	600	600	600	600
<b>Auxiliary Contacts (cULus)</b>		A600	A600	A600	A600	A600
<b>Cable cross-sections</b>						
for main connectors	solid AWG flexible AWG	18 - 10 18 - 10 1			16 - 10 14 - 4 1	
Cables per clamp						

1) Suitable for: earthed-neutral systems, overvoltage category I to IV, pollution degree 3 (standard-industry):  $U_{imp} = 8kV$ . Data for other conditions on request.

## Pole Changing Starters

Data according to IEC 947-4-1, VDE 0660, EN 60947-4-1

Type		K3NPU18	K3NPU24	K3PU32	K3PU50	K3PU62
<b>Main Contacts</b>						
<b>Rated insulation voltage <math>U_i</math><sup>1)</sup></b>	V AC	690	690	690	690	690
<b>Utilization category AC3</b>						
<b>Switching of three-phase motors</b>						
Rated operational current $I_e$	220V A 230V A 240V A	18 17,5 17	23 23 23	30 30 30	45 45 45	63 60 60
	<b>380-400V A</b>	<b>16</b>	<b>23</b>	<b>30</b>	<b>45</b>	<b>60</b>
	415V A 440V A	16 16	23 23	30 30	45 45	60 60
	500V A 660V A 690V A	16 9 8,5	23 17,5 17	30 21 20	45 33 31	55 42 40
Rated operational power of three-phase motors 50-60Hz	220-230V kW 240V kW <b>380-400V kW</b>	5 5 <b>7,5</b>	6 7 <b>11</b>	8,5 9 <b>15</b>	12,5 13,5 <b>22</b>	18,5 19 <b>30</b>
	415-440V kW 500V kW 660-690V kW	8,5 10 7,5	12 15 15	16 18,5 18,5	24 30 30	33 37 37
<b>Cable cross-sections</b>						
Line	solid or stranded mm <sup>2</sup> flexible mm <sup>2</sup>	0,75 - 6 1 - 4 0,75 - 4 1		1,5 - 25 2,5 - 16 1,5 - 16 1		4 - 50 6 - 35 6 - 35 1
	flexible with multicore cable end mm <sup>2</sup>					
Cables per clamp						
<b>Power consumption of the combination</b>						
inrush and change-over	VA	55		128		178
sealed	VA	20		26		31
	W	6		8		11

1) Suitable for: earthed-neutral systems, overvoltage category I to IV, pollution degree 3 (standard-industry):  $U_{imp} = 8kV$ . Data for other conditions on request.


## Star-Delta Starters

### Wiring Diagrams Main Circuit

Terminal markings of contactors and relays according to DIN EN 50012  
Connections shown in main and circuits as broken lines are not included.


#### K3NY15 to K3Y100

with thermal overload relay U3/.. or U12/16

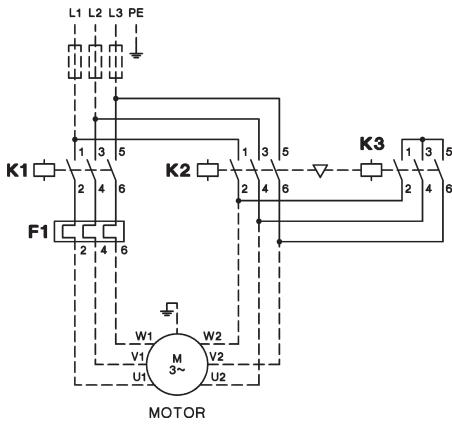

#### K3Y140 to K3Y300


with thermal overload relay U85 or U180

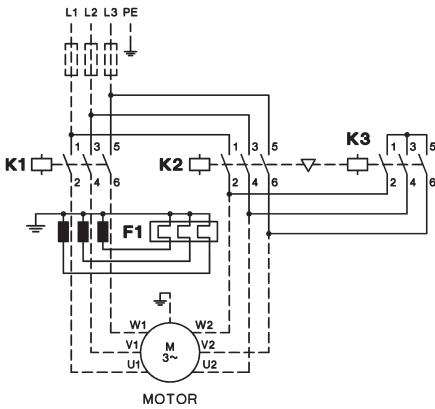

### Wiring Diagrams Control Circuit


#### K3NY15 to K3Y52

operating with control switch

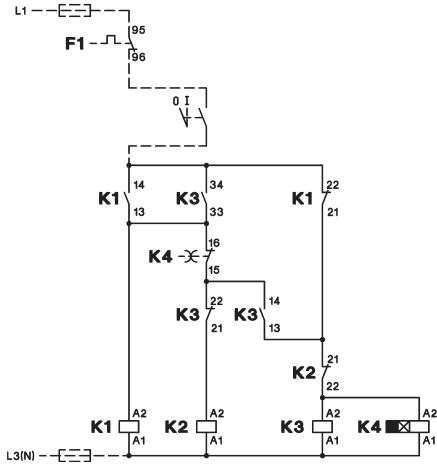


#### K3NY15 to K3Y52

operating with push buttons

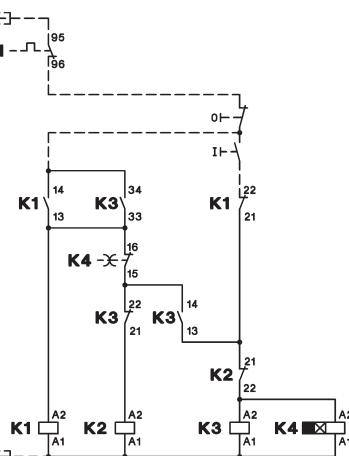


#### K3Y80 to K3Y200

operating with control switch

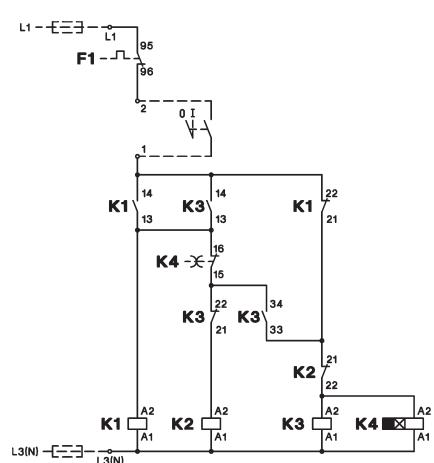


#### K3Y80 to K3Y200

operating with push buttons

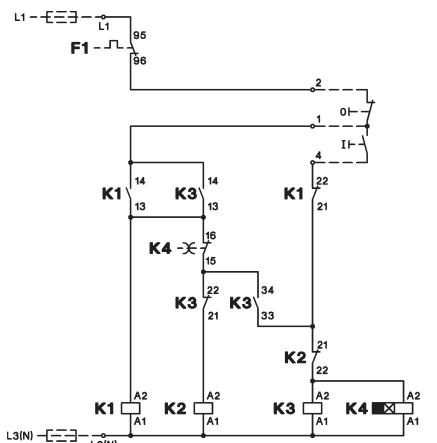


#### K3Y240 to K3Y300

operating with control switch

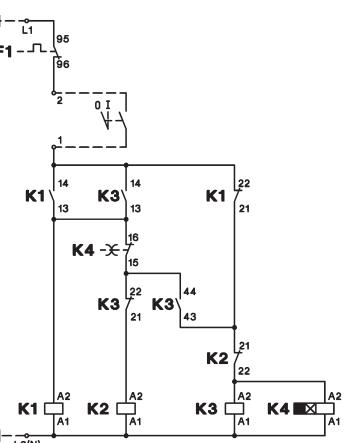

#### K3Y240 to K3Y300

operating with push buttons

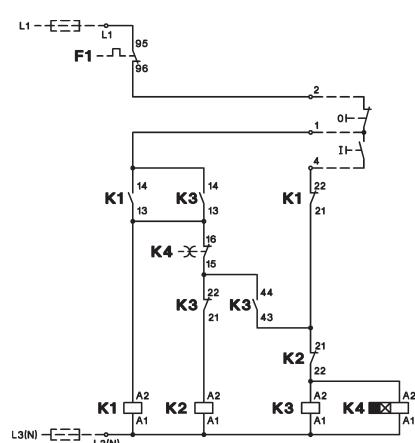


# Star-Delta Starters

## Wiring Diagrams Main Circuit

Terminal markings of contactors and relays according to DIN EN 50012  
Connections shown in main and control circuits as broken lines are not included.


### K3YL..

Typical circuit diagram

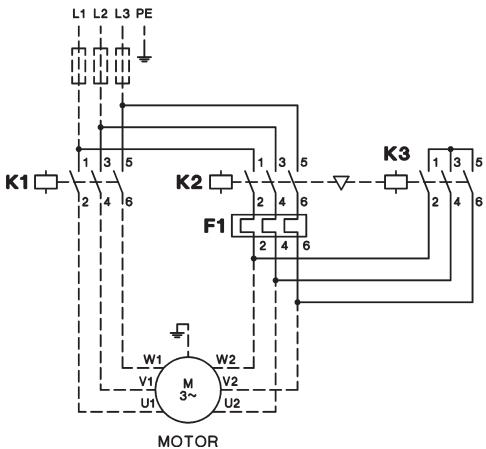

### K3Y.. with 2 Thermal Overload Relays

Typical circuit diagram

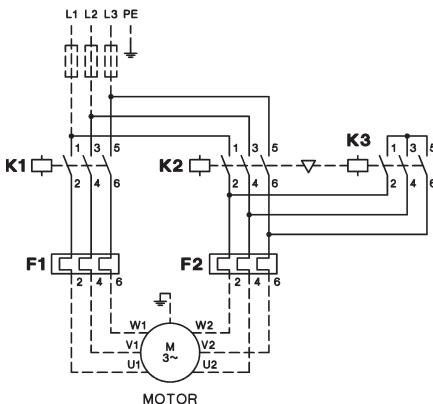


## Wiring Diagrams Control Circuit


### with selector switch

#### K3Y..W

Typical circuit diagram  
operating with control switch

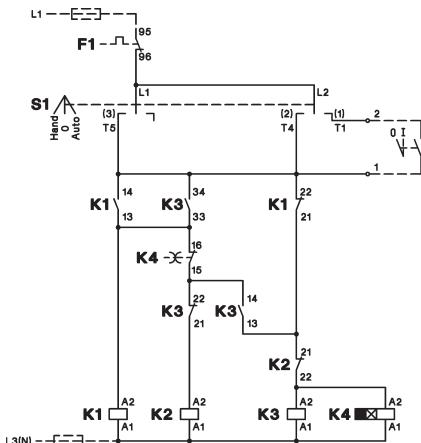


Typical circuit diagram  
operating with push buttons

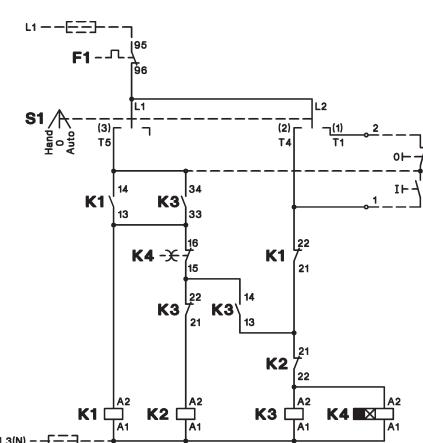

### with push buttons

#### K3Y..T

Typical circuit diagram

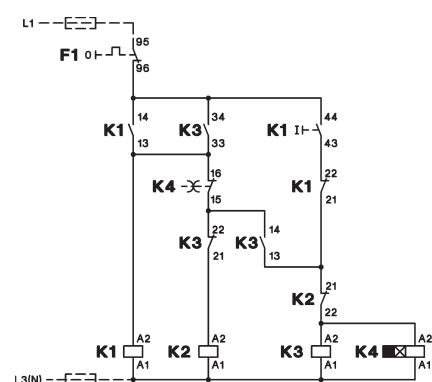


## Reversing Contactors

### Wiring Diagrams Main Circuit

Terminal markings of contactors and relays according to DIN EN 50012  
Connections shown in main and control circuits as broken lines are not included.

#### K3NWU10 to K3WU74

with thermal overload relay U3/32, U3/42 or U3/74

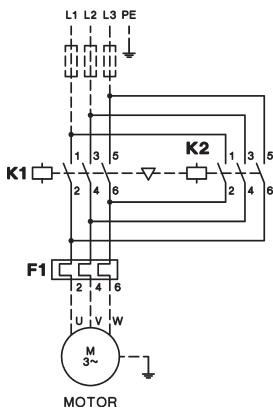


### Wiring Diagrams Control Circuit


#### K3NWU10 to K3WU32

operating with control switch


operating with push buttons  
**Reversing over off-position**

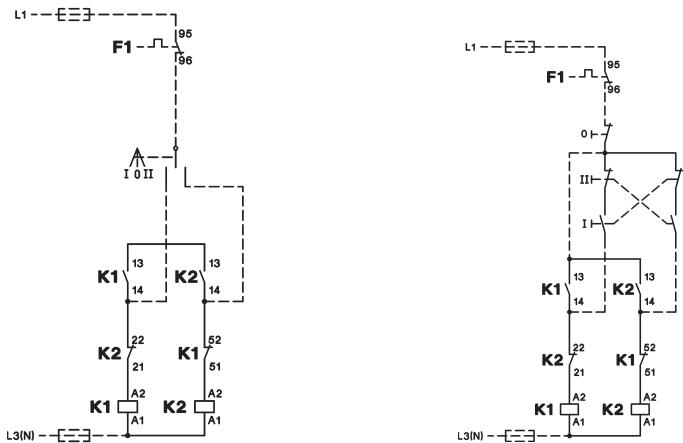

#### Reversing direct

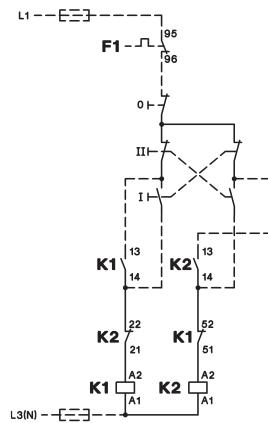

### K3WU50, K3WU62, K3WU74

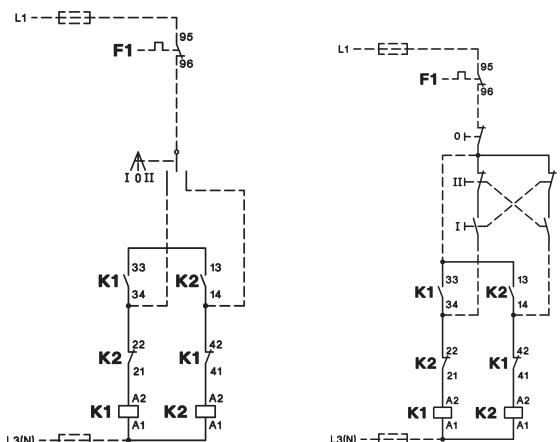


# Pole Changing Starters

## Wiring Diagrams


Terminal markings of contactors and relays according to DIN EN 50012  
Connections shown in main and control circuits as broken lines are not included.

### Main Circuit

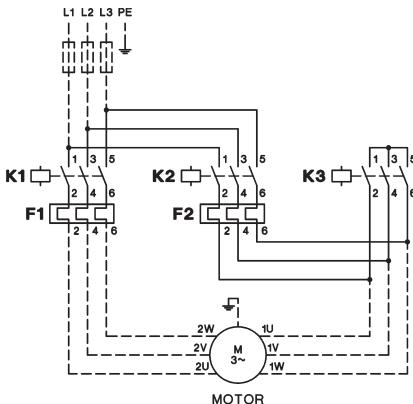


### Principal Control Circuit Wiring Diagram

operating with control switch

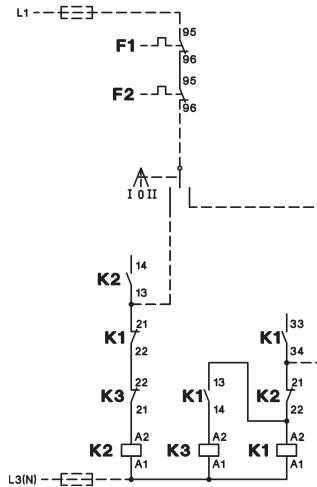



operating with push buttons

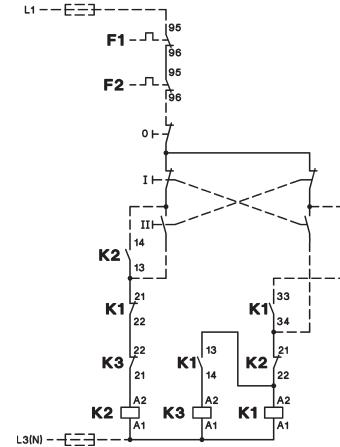

Operation  
Speed relation  
Power relation

	Low speed	High speed
Delta		
1	1	2
1,5 - 1,8		

	Low speed	High speed
Star		
1	0,3	2
1		1

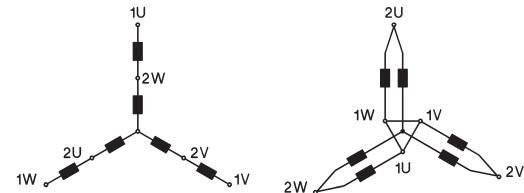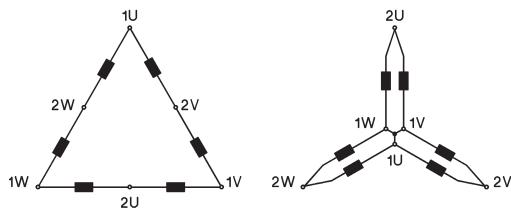


# Star-Delta Starters


## Dimensions

**Star-Delta Starters, AC operated, open type**


K3NY15 + U3/32  
K3NY26

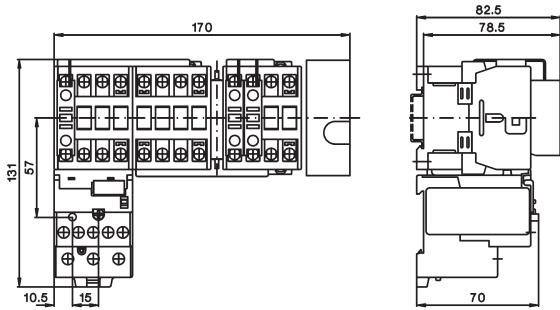


K3Y40 + U3/32  
K3Y52 + U3/32

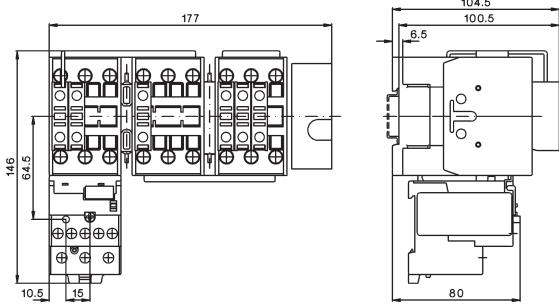


K3Y80 + U3/74

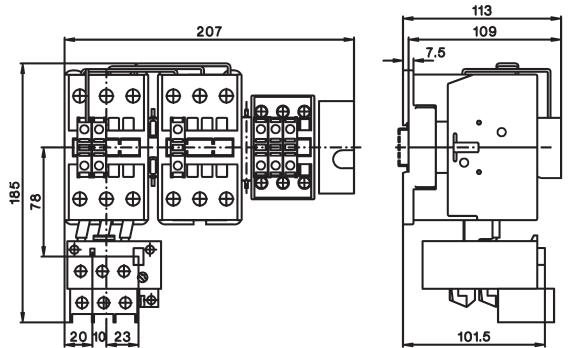


K3Y140 + U85  
K3Y200

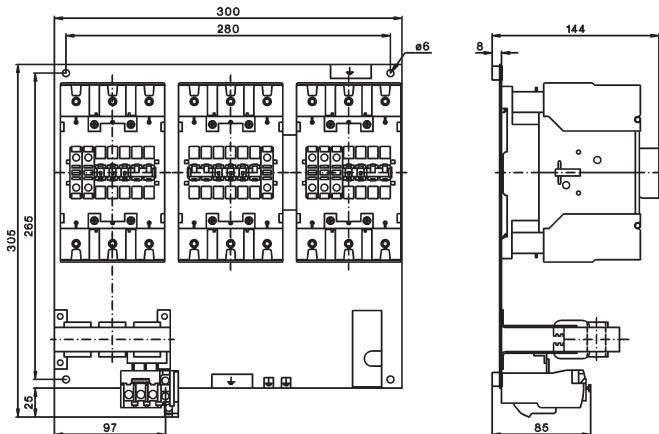


K3NY15 + U12/16E G3  
K3NY26

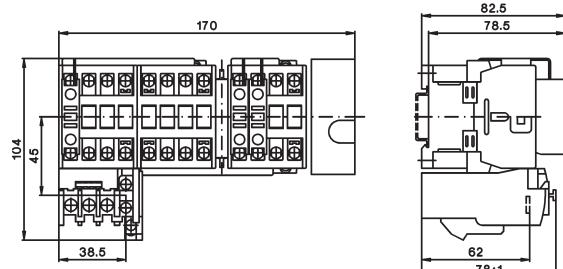


K3Y40 + U3/42  
K3Y52 + U3/42

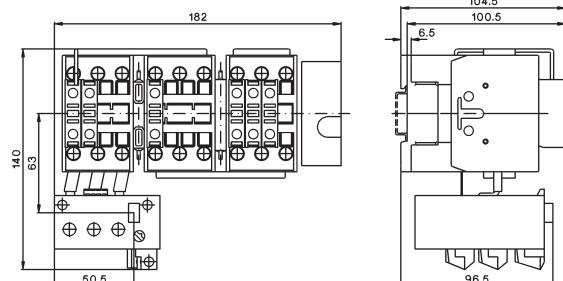

K3Y100 + U3/74

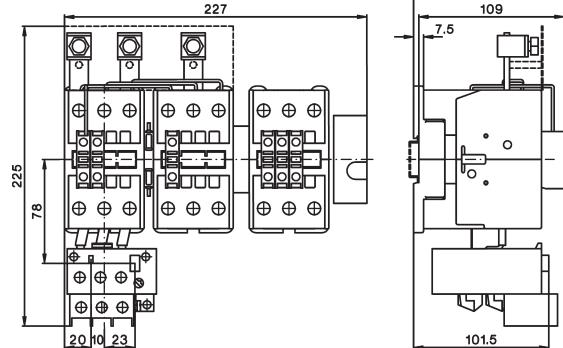

K3Y240 + U180 + SU180/176  
K3Y300

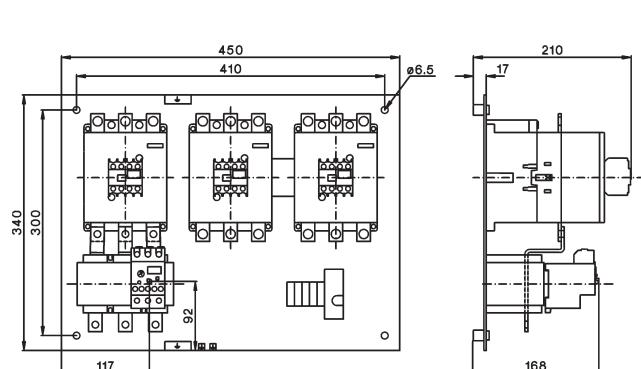


## Star-Delta Starters


### Dimensions

**Star-Delta Starters, plastic enclosed**, protected to IP65

K3NY26P

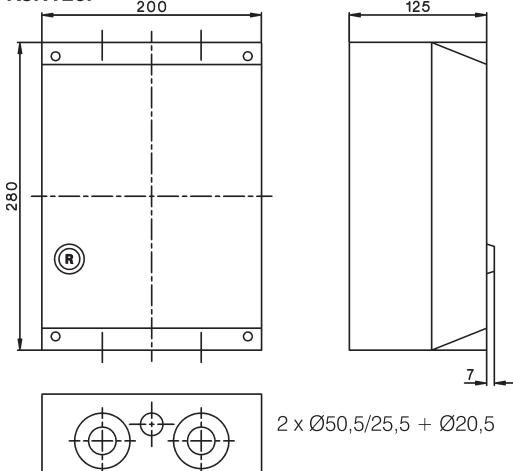

K3Y40P to K2Y100P

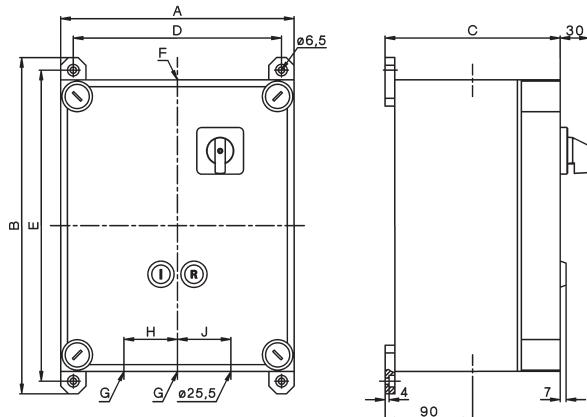



Type	A	B	C	D	E	Ø F	Ø G	H	J
<b>K3Y40P</b>	300	346	180	272	320	6,5	32,5	32,5	60
<b>K3Y52P</b>	300	346	180	272	320	6,5	32,5	32,5	60
<b>K3Y80P</b>	300	446	180	272	420	6,5	40,5	40,5	70
<b>K3Y100P</b>	300	446	180	272	420	6,5	50,5	40,5	70

**Star-Delta Starters, sheet steel enclosed**, protected to IP54

K3Y26B to K3Y52B

Type	Ø F	Ø G
<b>K3NY26B</b>	25,5	25,5
<b>K3Y40B</b>	32,5	32,5
<b>K3Y52B</b>	32,5	32,5


Mounting by included fixing link

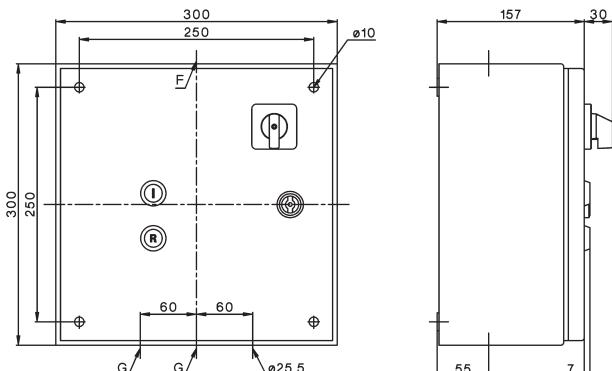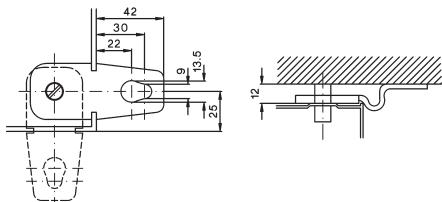

K3Y80B to K2Y200B

Type	A	B	C	D	E	L	M
<b>K3Y80B</b>	380	380	210	340	340	8,7	65
<b>K3Y100B</b>	380	380	210	340	340	8,7	65
<b>K3Y140B</b>	380	600	210	560	340	8,7	65
<b>K3Y200B</b>	380	600	210	560	340	8,7	65

Type	Ø F	Ø G	H	J	K
<b>K3Y80B</b>	40,5	40,5	70	70	60
<b>K3Y100B</b>	50,5	40,5	80	70	60
<b>K3Y140B</b>	50,5	50,5	80	80	70
<b>K3Y200B</b>	50,5	50,5	80	80	70

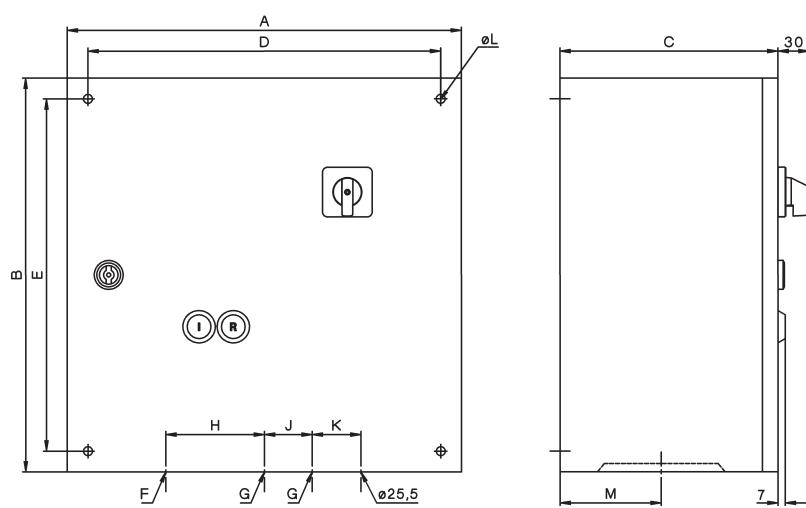


## Reversing Contactors


### Dimensions

Reversing Starters, AC operated, open type


K3NWU10 + U3/32  
K3NWU18

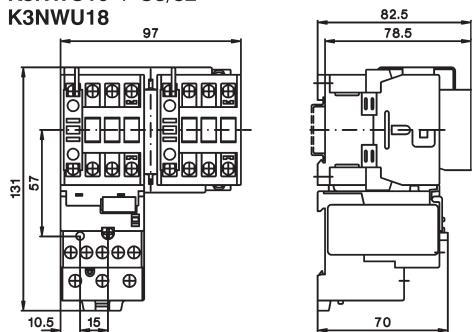


K3NWU10 + U12/16E G3  
K3NWU18

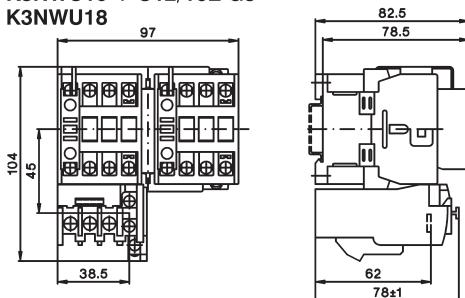


K3WU24 + U3/32  
K3WU32  
K3WU40

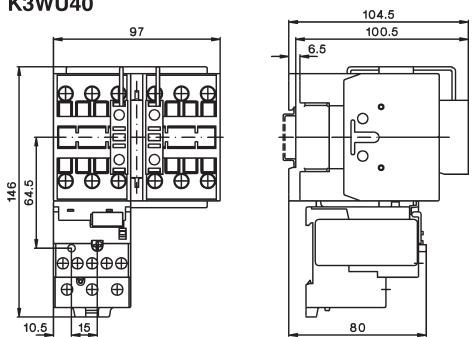

K3WU24 + U3/42  
K3WU32  
K3WU40

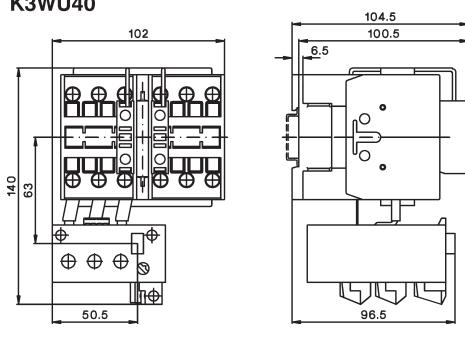



K3WU50 + U3/74  
K3WU62  
K3WU74

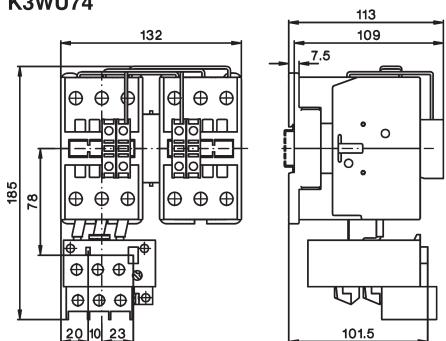

Reversing Contactors, sheet steel enclosed, protected to IP54

Type	A	B	C	D	E	F	G	H	K
K3NWU18B	300	300	150	250	250	30	30	Ø25,5	41
K3WU24B	300	300	150	250	250	30	30	Ø32,5	41
K3WU32B	300	300	150	250	250	30	30	Ø32,5	41
K3WU50B	300	300	150	250	250	40	40	Ø32,5	59
K3WU62B	300	300	150	250	250	40	40	Ø32,5	59

Mounting by included fixing link

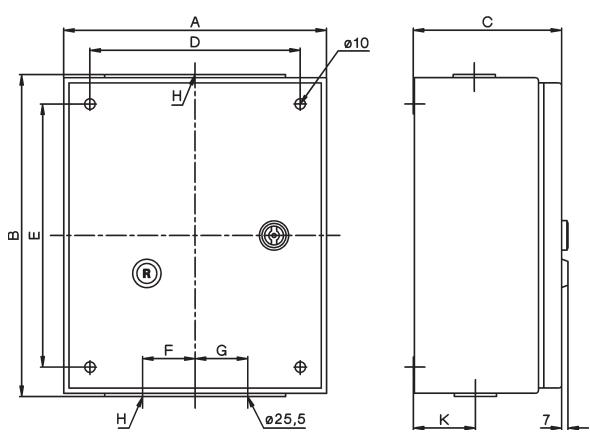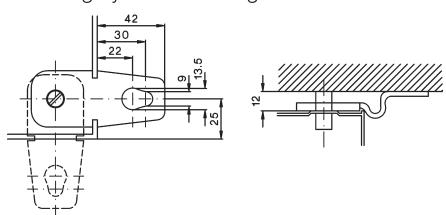


# Pole Changing Starters


## Dimensions

Pole Changing Starters, AC operated, open type

K3NPU18 + 2x U3/32

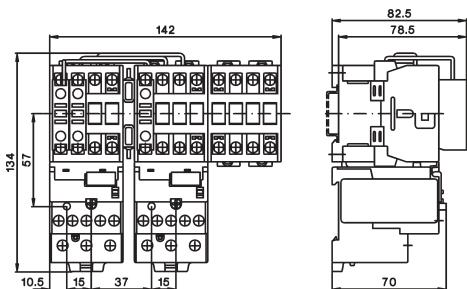


K3NPU18 + 2x U12/16

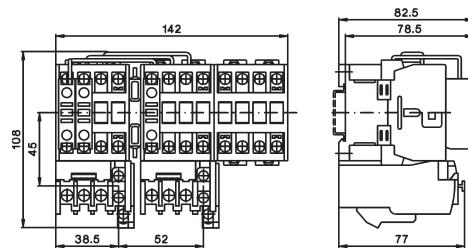


K3PU24 + 2x U3/32

K3PU32

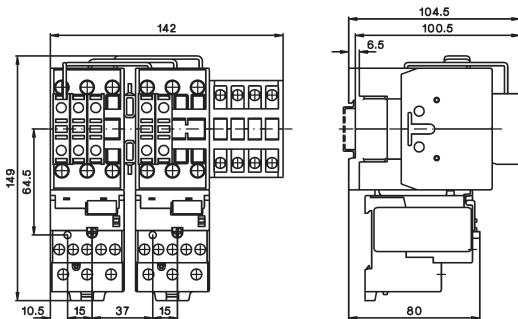

K3PU50 + 2x U3/74

K3PU62

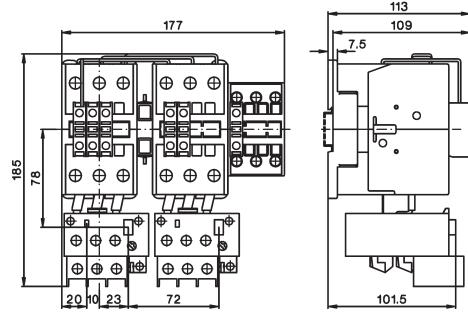

Pole Changing Starters, sheet steel enclosed, protected to IP54

K3NPU18B to K3PU32B

Type	$\varnothing$ F	$\varnothing$ G
K3NPU18B	25,5	25,5
K3PU24B	32,3	32,5
K3PU32B	32,3	32,5

Mounting by included fixing link

